

## PRESSURE TRANSMITTER WITH DATALOGGER AND DISPLAY FOR LEVEL MEASUREMENT DL/N



66

### Features

- Compact and robust stainless steel assembly 1.4435 (316L)
- Piezoresistive measuring element
- Gauge or absolute
- Pressure ranges from 0...1 m to 0...250 m water gauge
- Calibration available for all common pressure units mWS, mWC etc.
- Temperature measurement (optional)
- Measuring interval programmable from 2 s to 24 h
- Non volatile data memory for 130'000 measurements
- High battery life (up to 10 years)
- Transfer of data to a laptop/handheld computer without removing the datalogger

### Typical applications

Recording of level measurement in

- Phreatic Water
- Bore holes
- Waste water
- Reservoirs
- Lakes, rivers
- Sewage treatment plant

## Specifications

Pressure range	[mH <sub>2</sub> O]	1 ... 5	> 5 ... 20	> 20 ... 250
<b>Overpressure</b>		3 bar	3 x FS (min. 3 bar)	3 x FS
<b>Accuracy</b> <sup>1)</sup>	[± % FS]	≤ 0.25	≤ 0.1	≤ 0.1
<b>Thermal shift</b>	[± % FS/°C]			
Zero	-5...50°C	0.06	0.03	0.015
Span	-5...50°C	0.015	0.015	0.015
<b>Temperature range</b> <sup>2)</sup>			-5...50°C	

<sup>1)</sup> Zero based non-conformity according to DIN 16086, including hysteresis and repeatability

<sup>2)</sup> Other temperature range on request

### Datalogger

<b>Units</b>	Pressure, pressure and temperature (temperature as option)
<b>Resolution</b>	Pressure < 0.01% FS      Temperature 0.1°C
<b>Real time clock</b>	Quartz clock with date, start of first measurement programmable
<b>Data memory</b>	130'000 measurement values - non volatile, data kept in memory even without battery      - each measurement value is correlated with time and date
<b>Interface</b>	Infrared
<b>Identification</b>	Serial number and programmable Id. number
<b>Power supply</b>	2x Lithium battery 3.6V / size AA      - on site battery change

### Configuration and Data Transfer

#### PC-Program for Configuration and Data Transfer

<b>System Requirements</b>	IBM compatible laptop or PC, Windows 95/98/NT or handheld PC with Windows CE 2.11 or upward	
<b>Data Transfer</b>	- data transfer of last measurement period - data transfer for a defined time-period - the data will be represented in a txt.file or in a graph	- data transfer of all data
<b>Configuration</b>	- sampling rate - number of replicates - time and date - description - starting time of first sample - depth to water - tare - upper and lower threshold value - storage threshold value - density of the measuring media - switch on/off the Datalogger - printer	time between two records  (e.g. name of location)  the actual pressure value can be set to the real value min./max. value (optional) the density-setting will affect the level range (optional) using the switches on the display (optional) (optional)
<b>Data Format</b>	Data are stored in ASCII format and may be read with programs like Excel, Lotus or similar	

## Electromagnetic compatibility

	Standard	Level	Typical interferences
<b>Emission:</b>			
EN 50081-1:1992	Generic emission standard		
EN 55022:1994	Emission, class B		
<b>Immunity:</b>			
EN 50082-2:1995	Generic immunity		
EN 61000-4-2:1995	Electrostatic discharge	4kV contact, 8kV air	
ENV 50140:1993	Radiated electro-magnetic field	10V/m, 80-1000 MHz, 80% AM 1kHz	Cellular phones, radio sets
ENV 50204:1995	Radiated electro-magnetic field (GSM)	10V/m, 950 MHz, 200Hz on/off	Digital portable phones
EN 61000-4-4:1995	Fast transients (burst)	2 kV	Motors, valves
ENV 50141:1993	Conducted radio-frequency	10V, 0.15-80 MHz, 80% AM 1kHz	Cellular phones, radio sets



The pressure transmitter DL fulfill the emission and immunity requirements described in the EMC directive 89/336/EEC.

## Ordering Information

66 X . 99XX . 9595 . X4 . XXX

<b>Type</b>	DL/N with display	66						
<b>Pressure Type</b>	Gauge	1						
	Absolute	2						
<b>Pressure range<sup>5)</sup></b>	0... 1.0 mH2O							
	0... 1.6 mH2O							
	0... 2.5 mH2O							
	0... 4.0 mH2O							
	0... 6.0 mH2O							
	0... 10 mH2O							
	0... 16 mH2O							
	0... 25 mH2O							
	0... 40 mH2O							
	0... 60 mH2O							
	0... 100 mH2O							
	0... 160 mH2O							
	0... 250 mH2O							
	Special calibration							
<b>Version</b>	housing for pipe mounting, closed <sup>1)</sup>	(Fig. 2a/1)	57					
	housing for pipe mounting, open <sup>1)</sup>	(Fig. 2b/1)	58					
	housing for pipe mounting, screwed on, closed <sup>1) 2)</sup>	(Fig. 3a/4)	72					
	housing for pipe mounting, screwed on, open <sup>1) 2)</sup>	(Fig. 3b/4)	73					
<b>Cable</b>	PE cable <sup>3) 6)</sup>							
	PUR cable <sup>3)</sup>							
	Teflon cable <sup>3)</sup>							
<b>Interface</b>	Infrared <sup>7)</sup>			95				
<b>Accuracy</b>	≤ ±0.25% FS (for pressure ranges ≤ 500 mbar)					1		
	≤ ±0.1 % FS (for pressure ranges > 500 mbar)					2		
<b>Temperature range</b>	-5...50°C <sup>4)</sup>					4		
<b>Options</b>	Ballast weight						B	
	Electronics packed in gel:	Gauge pressure					C	
		Absolute pressure					D	
	Temperature measurement						E	
	Special oil filling:	ASEOL Food						G
		Halocarbon						H
	Seals:	EPDM						S
		Kalrez						T
Special options						Z		

<sup>1)</sup> Version for pipe mounting, minimum diameter 2"

<sup>2)</sup> Gauge version for cable length > 50m

<sup>3)</sup> Please specify the required cable length and media

<sup>4)</sup> Other temperature range on request

<sup>5)</sup> mWS, mWC etc. available

<sup>6)</sup> Suitable for drinking water (food approved)

<sup>7)</sup> Infrared data transfer cable **not** included (ordering code VART144)

## Dimensions


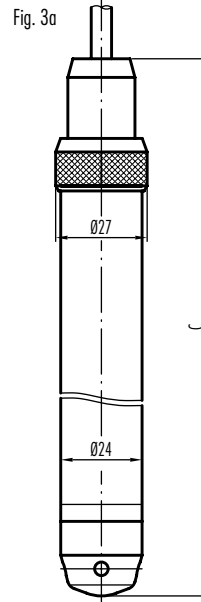
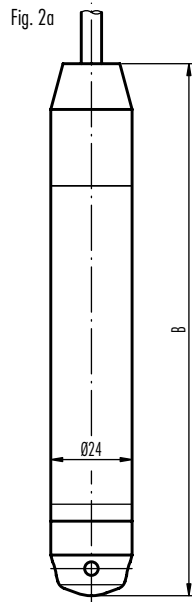
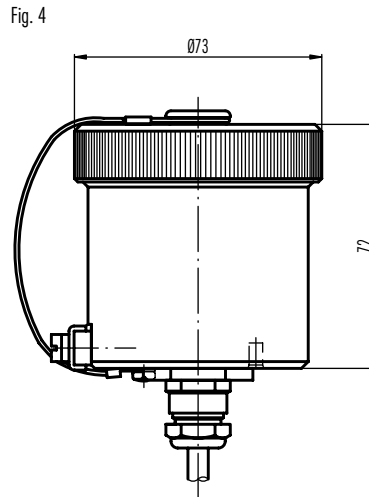
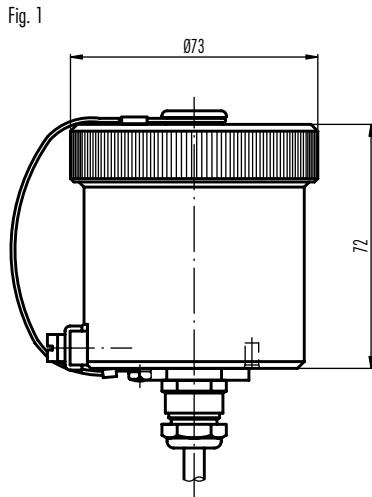


Fig. 1 Battery housing for Datalogger and display  
 Fig. 4 Battery housing for display  
 Fig. 3a/3b Battery built into the transmitter housing

Version	Front	Fig.	Length	Weight [g]	Length <sup>3)</sup>	Weight <sup>3)</sup> [g]
gauge	closed	2a	B=157	195	B=244	425
	open	2b	B=153	195	B=240	425
	closed	3a	C=259.5	300		
	open	3b	C=255.5	300		

<sup>3)</sup> with ballast weight

Specifications may change without notice. Stand 06/01

### Switzerland

STS Sensor Technik Sirmach AG  
 Rütihofstrasse 8  
 CH - 8370 Sirmach  
 Tel.: (071) 969 49 29  
 Fax: (071) 969 49 20  
 e-mail: sales@sts-ag.ch  
 Internet: www.sts-ag.ch

### Germany

STS Sensoren Transmitter Systeme GmbH  
 Mercedesstrasse 1  
 D - 71063 Sindelfingen  
 Tel.: (07031) 811 920  
 Fax: (07031) 811 958  
 e-mail: sts.gmbh@t-online.de  
 Internet: www.sts-ag.ch

### Italy

STS Italia s.r.l.  
 Via Gesù 5  
 I - 20090 Opera (MI)  
 Tel.: 02-57607073/074  
 Fax: 02-57607110  
 e-mail: stsopera@tin.it  
 Internet: www.sts-ag.ch

### represented by